


- NOTES:
1. DECREASING THRESHOLD THICKNESS TO LESS THAN 1/2" MAY BE REQUIRED TO ENSURE 1/8" MAXIMUM ALLOWABLE OFFSET WHERE ABUTTING EXISTING CERAMIC TILE - FIELD VERIFY.
 2. WHERE THRESHOLD ABUTS CARPET, NO LEVELING COMPOUND IS REQUIRED. MAXIMUM ALLOWABLE HEIGHT DIFFERENCE BETWEEN THRESHOLD AND CARPET IS 1/16". HOLD OFFSET HEIGHT CONSTANT ACROSS THRESHOLD.
 3. THIS THRESHOLD DETAIL IS TO BE USED AT ALL M.D. ANDERSON RESTROOMS.

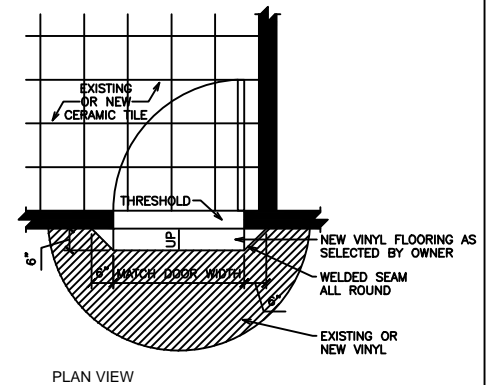

MD ANDERSON CANCER CENTER
Facilities Planning Design & Construction

ISSUE	DATE
△	09-06-2007

TYPICAL RESTROOM
DOOR THRESHOLD

Facility Program Standard Detail

AF-066116-01