



PROVIDE MINIMUM 24" HORIZONTAL SEPARATION IN ACOUSTIC-RATED WALLS

SEPARATE CONDUIT TOP ENTRANCE FOR EACH DEVICE. NO HORIZONTAL CONDUIT UNLESS OTHERWISE NOTED.

FLUSH MOUNTED BOX

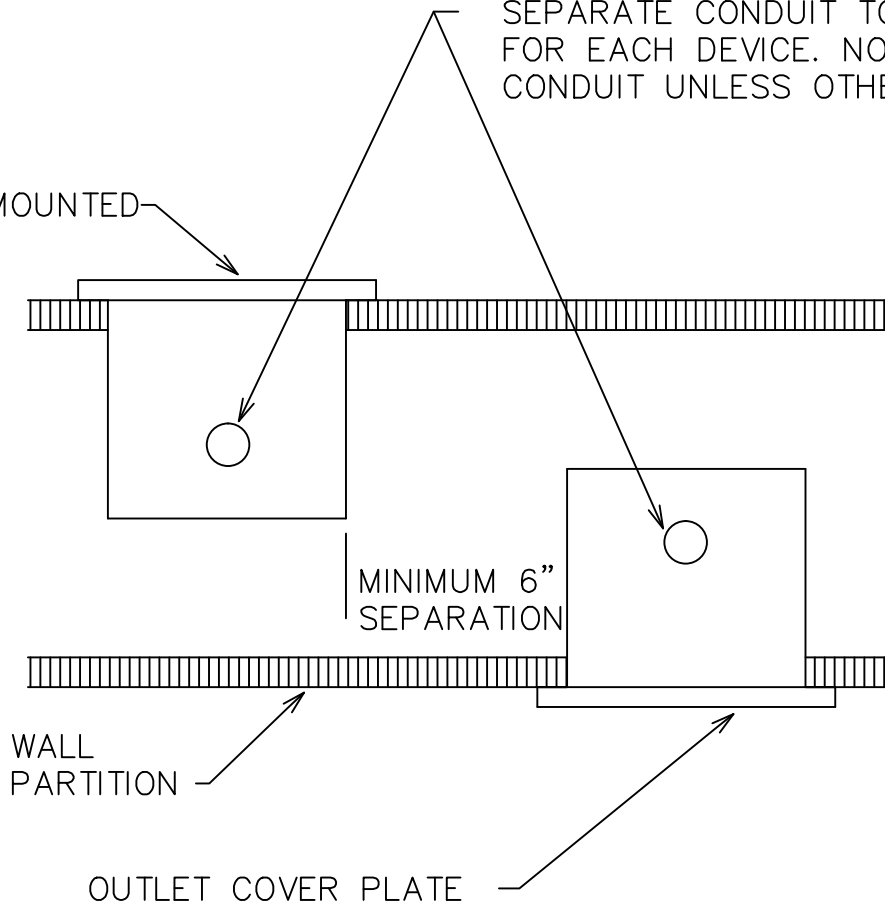

MD ANDERSON CANCER CENTER  
Facilities Planning Design & Construction

ISSUE	DATE
	10-15-2009

BACK-TO-BACK  
WALL OUTLETS

Facility Program Standard Detail

EE-260533-01